

DEPARTMENT OF PUBLIC HEALTH AND PREVENTIVE MEDICINE
SANITARY CERTIFICATE

(Under Tamil Nadu Educational Rules - Appendix – 3 - Chapter III - Rule: 24)


Name and Address of the Institution:

THE CORRESPONDENT,
VAANI PUBLIC SCHOOL,
S.F.NO.96/3, RANIPET TO KRISHNAGIRI TRUNK ROAD,
INDRA NAGAR, CHETTIYAPPANUR, KALANDIRA VILLAGE,
VANIYAMBADI TALUK, TIRUPATHUR DISTRICT.

I hereby declare that I have inspected the above institution premises on 01.06.2023 and Sanitary Certificate is issued, subject to following terms and conditions.

- ✧ That the accommodation provided for each of the several classes is sufficient for the minimum number of pupils taught therein and is properly ventilated and lighted
- ✧ That the building is maintained in substantial repair
- ✧ That it is neat and clean
- ✧ That the latrine arrangements are adequate and satisfactory
- ✧ That the supply of drinking water is wholesome and
- ✧ That in all other necessary respects the sanitation is good
- ✧ Subject to the Condition that proper signage boards are placed displaying “ No smoking area – Smoking here is an offence ” and “ Sale of tobacco products around 100 yards of this institution is banned ” and complying with the provisions already prescribed for Smoke Free Educational institutions.
- ✧ Proper gloves, shoes, Mask and Hand sanitizer should be provided to all Staffs and Students and there are always keep the Social Distance in the School premises for Prevention of Covid-19 infective disease.
- ✧ Subject to the Condition that proper signage boards are placed displaying “ Plastic Free Zone ” and “ Tobacco free Zone ”


This certificate is valid for One year from the date of issue.

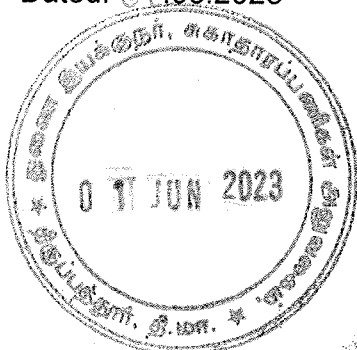

Signature and seal of BHS,
Block Health Supervisor,
Community Health Centre,
Pudupettai-635 651.
Jolarpettai Block, TPT.Dist.


K.DIS.NO.3360 / A3 / 2023
Dated: 01.06.2023

O/o The Deputy Director of
Health Services, Tirupattur District.

Counter signed.


Deputy Director of Health Services,
Tirupattur District.




01-6-23


**PERFORMA FOR SAFE DRINKING WATER AND SANITARY
CONDITION CERTIFICATE**

No.3360

Date: 01.06.2023

It is certified that an inspection team headed by **Mr. C.Muthukishnan** **Block Health Supervisor** (Name of officers with designation) from **Public Health Department** (Name of the Department/Office) inspected **Vaani Public School, S.F.NO.96/3, Ranipet To Krishnagiri Trunk Road, Indira Nagar, Chettiyappanur, Kalandira Village, Vaniyambadi Taluk, Tirupattur District, 635 751.** (Name & Address of the school) on **01.06.2023** date of inspection), checked the water test report submitted by the school and found that the school has potable drinking water for students and staff of the institution and is having provision for running water in the toilets and **Maintaining hygienic sanitation condition in the school building & the campus** as per the norms prescribed by the **Central/State/U.T Govt.**

The above valid for a period of One Year

Signature with seal: 
Name : Block Health Supervisor,
Designation : Community Health Centre,
Pudupettai-635 651.
Jolarpettai Block, TPT.Dist.

To

The correspondent,
Vaani Public School,
S.F.NO.96/3, Ranipet To Krishnagiri Trunk Road,
Indira Nagar, Chettiyappanur, Kalandira Village,
Vaniyambadi Taluk, Tirupattur District, 635 751.



TAMILNADU WATER SUPPLY AND DRAINAGE BOARD

DISTRICT WATER TESTING LABORATORY

No.34,1st Cross, Mohan Rao Colony,
Krishnagiri -635001.

Phone: 04343-233356

E-mail:jwakrishnagiri@gmail.com



TC-10325

TEST REPORT

Doc.No: DWTL/FORM/7.8/01

Report No: TR/2023/ 47018-1

Report Issue Date : 29.11.2023 Page No : 01 of 01

Invoice Details: 036/Dt27.11.2023

ULR No

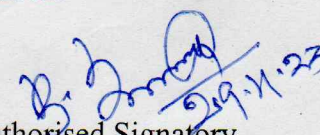
TC103252300047018F

Client Name & Address Contact No / Email.ID	:	Vanni Public school, Vaniyambadi Thirupattur-635751. Mobile:8056350086.
Sample Name	:	Water
Sample Number	:	47018
Sample Description	:	Bore Well
Sample Submitted by	:	Dr.Lakshmanan
Location & Date	:	Vanni Public school (BW) & 27.11.2023
Quantity of sample Received	:	2L
Sample Container	:	Plastic - Good
Sample Condition on Receipt	:	Good
Sample Received On	:	27.11.2023
Test Commenced on	:	27.11.2023
Test Completed on	:	27.11.2023
Environmental Condition	:	23.0°C – 27.0°C

S.No	Parameters	Unit	Test Method	Result	Specification as per IS 10500:2012(RA:2019)	
					Acceptable Limit	Permissible Limit in the absence of alternate source
1	pH @ 25° C	-	IS 3025 Part 11-1983	7.21	6.5-8.5	6.5-8.5
2	Total Hardness as CaCO ₃	mg/L	IS 3025 Part 21-2009	460	200	600
3	Total Alkalinity as CaCO ₃	mg/L	IS 3025-Part 23-1986	424	200	600
4	Chloride as Cl	mg/L	IS 3025-Part 32-1988	172	250	1000
5	Sulphate as SO ₄	mg/L	IS 3025-Part 24-1986	34	200	400
6	Nitrate as NO ₃	mg/L	APHA 23rd Edition 2017- 4500 -NO ₃ B	9	45	45
7	Fluoride as F	mg/L	APHA 23rd Edition 2017 - 4500- F-D	1.2	1.0	1.5

Note : The above given sample is confirmed to the drinking water specification as per IS10500:2012.

.....End of the report.....


Authorised Signatory
Junior Water Analyst
DWTL Krishnagiri

Note:

- 1.The test results relate only to the items tested.
- 2.The test report shall not be reproduced anywhere except in full and in the same format without the permission of the laboratory.
- 3.Unless informed by customer, the test items will not be retained for more than 15 days from the date of issue of the test report.
- 4.The result applied to the sample as received basis.

TAMILNADU WATER SUPPLY AND DRAINAGE BOARD



DISTRICT WATER TESTING LABORATORY

No.34,1st Cross, Mohan Rao Colony,
Krishnagiri -635001.

Phone: 04343-233356

E-mail:jwakrishnagiri@gmail.com

TEST REPORT


Doc.No: DWTL/FORM/7.8/01

Report No:	TR/2023/ 47018-1	Report Issue Date :	29.11.2023	Page No : 01 of 01
Invoice Details:	036/Dt27.11.2023	ULR No	TC103252300047018F	

S.No	Parameters	Test Method	Unit	Result	Specification as per IS 10500 : 2012	
8	Appearance	Physical observation	--	Clear	Clear	Clear
9	Odour	IS 3025 part 5 : 1983	--	Agreeable	Agreeable	Agreeable
10	Turbidity	APHA 23rd Edition 2017 - 2130 B	NTU	0.7	1	5
11	Total Dissolved Solids	APHA 23rd Edition 2017 - 2540 C	mg/L	933	500	2000
12	Conductivity	APHA 23rd Edition 2017 - 2510 B	µS/cm	1333	-	-
13	P - Alkalinity	IS 3025-part 23-1983	mg/L	-	-	-
14	Calcium	APHA 23rd Edition 2017 - 3500 Ca B	mg/L	110	75	200
15	Magnesium	APHA 23rd Edition 2017- 3500 Mg B	mg/L	44	30	100
16	Iron	APHA 23rd Edition 2017- 3500 Fe B	mg/L	0.00	0.3	1.0
17	Manganese	APHA 23rd Edition 2017 - 3500 Mn B	mg/L	-	0.1	0.3
18	Ammonia	APHA 17th Edition- 1989- 4500 NH3C	mg/L	0.5	0.5	0.5
19	Nitrite as NO ₂	APHA 23rd Edition 2017- 4500 -NO2 B	mg/L	0	-	-
20	Total Phosphate as PO ₄	APHA 23rd Edition 2017 - 4500 P- D	mg/L	0	-	-
21	Tidy's	APHA 23rd Edition 2017 - 4500 O - B	mg/L	-	-	-
22	Residual Chlorine	APHA 23rd Edition 2017 - 4500 O - B	mg/L	0	0.2	1.0

Note : The above given sample is confirmed to the drinking water specification as per IS10500:2012 with respect to above tested parameters.

.....End of the report.....


 29/11/23
 Authorised Signatory
 Junior Water Analyst
 DWTL Krishnagiri

Note:

1. The test results relate only to the items tested.
2. The test report shall not be reproduced anywhere except in full and in the same format without the permission of the laboratory.
3. Unless informed by customer, the test items will not be retained for more than 15 days from the date of issue of the test report.
4. The result applied to the sample as received basis.